

Job Name _____
 Purchaser _____
 Submitted to _____
 Unit Designation _____

Location _____
 Engineer _____
 Reference Approval Construction
 Schedule # _____

Specifications

Performance	Nominal Capacity ¹	Cooling (Btu/h)	24,000 (18,300 SH)	
		Heating (Btu/h)	27,000	
	Condensate	Pints/Hour	7.0	
Power	Voltage	ø / V / Hz	1 / 208-230 / 60	
	Nominal Running Current (A)		1.5	
Fan	Type		Sirocco (2)	
	Motor	Type	Non Feedback SSR (1)	
		Output (W)		124
Airflow	CFM (UL)	H/M/L	653 / 600 / 547	
	Total CFM Range ²		498 - 694	
External Static Pressure	Standard	"WC	0.157	
	Min. / Max.	"WC	0 - 0.315	
Refrigerant	Type		R410A	
	Control Method		Electronic Expansion Valve	
Piping Connections	Liquid (flare)	Inches	3/8	
	Suction (flare)	Inches	5/8	
	Drain	Inches	OD 1 1/4, ID 1	
Unit Dimensions	W X H X D	Inches	35 7/16 X 10 1/4 X 18 7/8	
	Weight	lbs.	64	
	Duct Connections (inches)	Supply		33 1/4 X 7 9/32
		Return		27 1/2 X 6 1/4
Sound Level	H / M / L	dB	39 / 35 / 31	
Accessories	Filter Box	<input type="checkbox"/>	FB-M1824	
	Condensate Pump	<input type="checkbox"/>	MDP-M075SGU3D	
	External Contact Control	<input type="checkbox"/>	MIM-B14	
	Wireless Receiver Kit	<input type="checkbox"/>	MRK-A10N	
	External Temperature Sensor	<input type="checkbox"/>	MRW-TA	
	CN83 Pigtail (for 12VDC VENT output)	<input type="checkbox"/>	DB39-01263A	
Safety Certifications			ETL & ETLc	



- Compatible with Samsung DVM S, DVM S Water, and DVM Eco systems (AM*****/AA).

- High-voltage terminal block temperature sensor to disable unit in the event overheating of power connection.

- Discharge air temperature sensor with target discharge temperature control capability

Construction

The unit shall be constructed of insulated, galvanized steel

Heat Exchanger

The heat exchanger shall be mechanically bonded fin to copper tube

Indoor Fan

Indoor fan is a centrifugal type with a single fan motor

Three fan speed settings and auto setting

Fan output can be configured during commissioning for various external static pressure ranges

Controls

The unit shall be operated via a wireless or wired remote control with DDC type signal

The unit shall integrate with the Samsung NASA Controls Network Solution

Controls shall integrate with a BMS system

Control wiring shall be 2 X 16 AWG shielded wire


Air Filtration

The unit shall ship with basic filtration as standard

Pressure drop across the filter must be factored into the total ESP.


¹ Nominal cooling capacities are based on: Indoor temperature: 80 °F DB, 67°F WB. Outdoor temperature: 95°F DB, 75°F WB.
 Nominal heating capacities are based on: Indoor temperature: 70 °F DB, 60°F WB. Outdoor temperature: 47°F DB, 43°F WB.

² Refer to technical data book for fan performance details and settings
 Samsung HVAC maintains a policy of ongoing development, specifications are subject to change without notice.

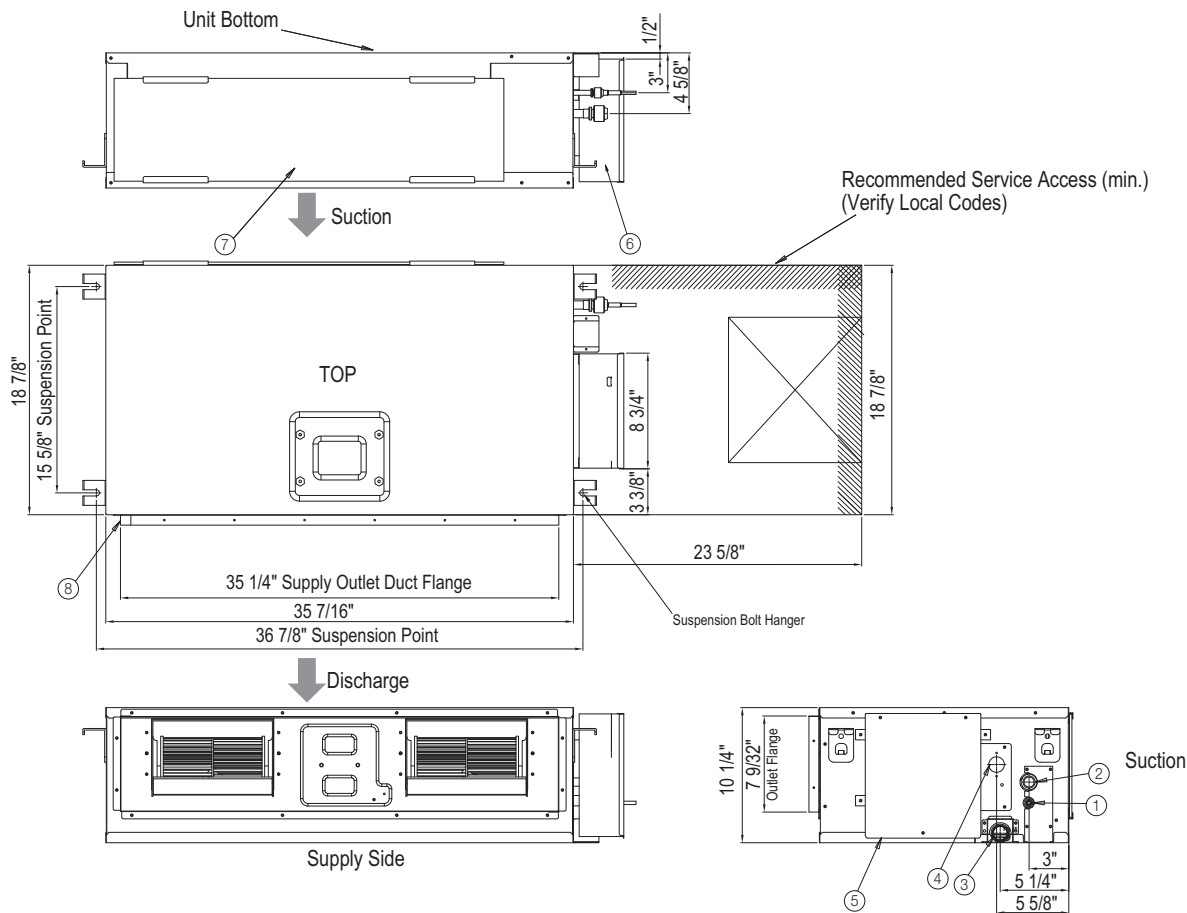


No.	Name	Description
①	Liquid Pipe Connection	Ø 3/8" Flare
②	Gas Pipe Connection	Ø 5/8" Flare
③	Drain Pipe Connection, Without Optional Condensate Pump	OD 1 1/4", ID 1"
④	Drain Pipe Connection, With Optional Condensate Pump	OD 1 1/4", ID 1"
⑤	Controls Box	-
⑥	Conduit for Power & Communication Wiring	-
⑦	Return Air Side	-
⑧	Supply Air Outlet Duct Flange	-

Inspection Opening Requirements

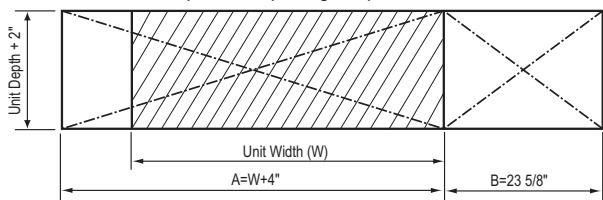

In applications where there is not a tile ceiling, an inspection hole is required.
 If height between ceiling and structure is 3.25' or more, inspection opening "B" is recommended.
 If height between ceiling and structure is less than 3.25', inspection opening "A" and "B" is recommended.
 (verify state and local codes).

Unit Clearance From Structure

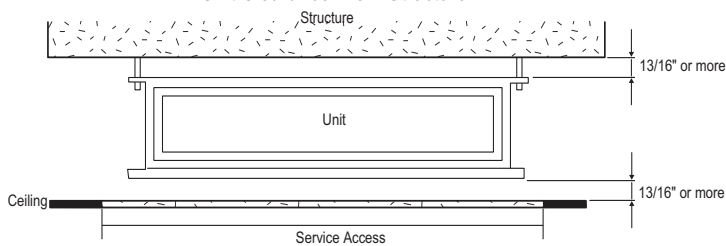

Fan Performance Data

